

TRCD. CH. DRWN. CHKD. ENGINEERS: APPROVED: ISSUE:

20-9-28
A 5-11-28
B 21-10-29
C 18-12-29

RELAY P WAS C.6708 X / P.G.5
TWIN CONTACTS WERE NOT INDICATED
C.103 A. METER WAS C.104 D.


ISSUE:

G.E.C. LTD TEL. WKS. COVENTRY.

50 V. R.A.X SYSTEM.

LINE CIRCUIT.

16772
DUPLICATE TRACING.

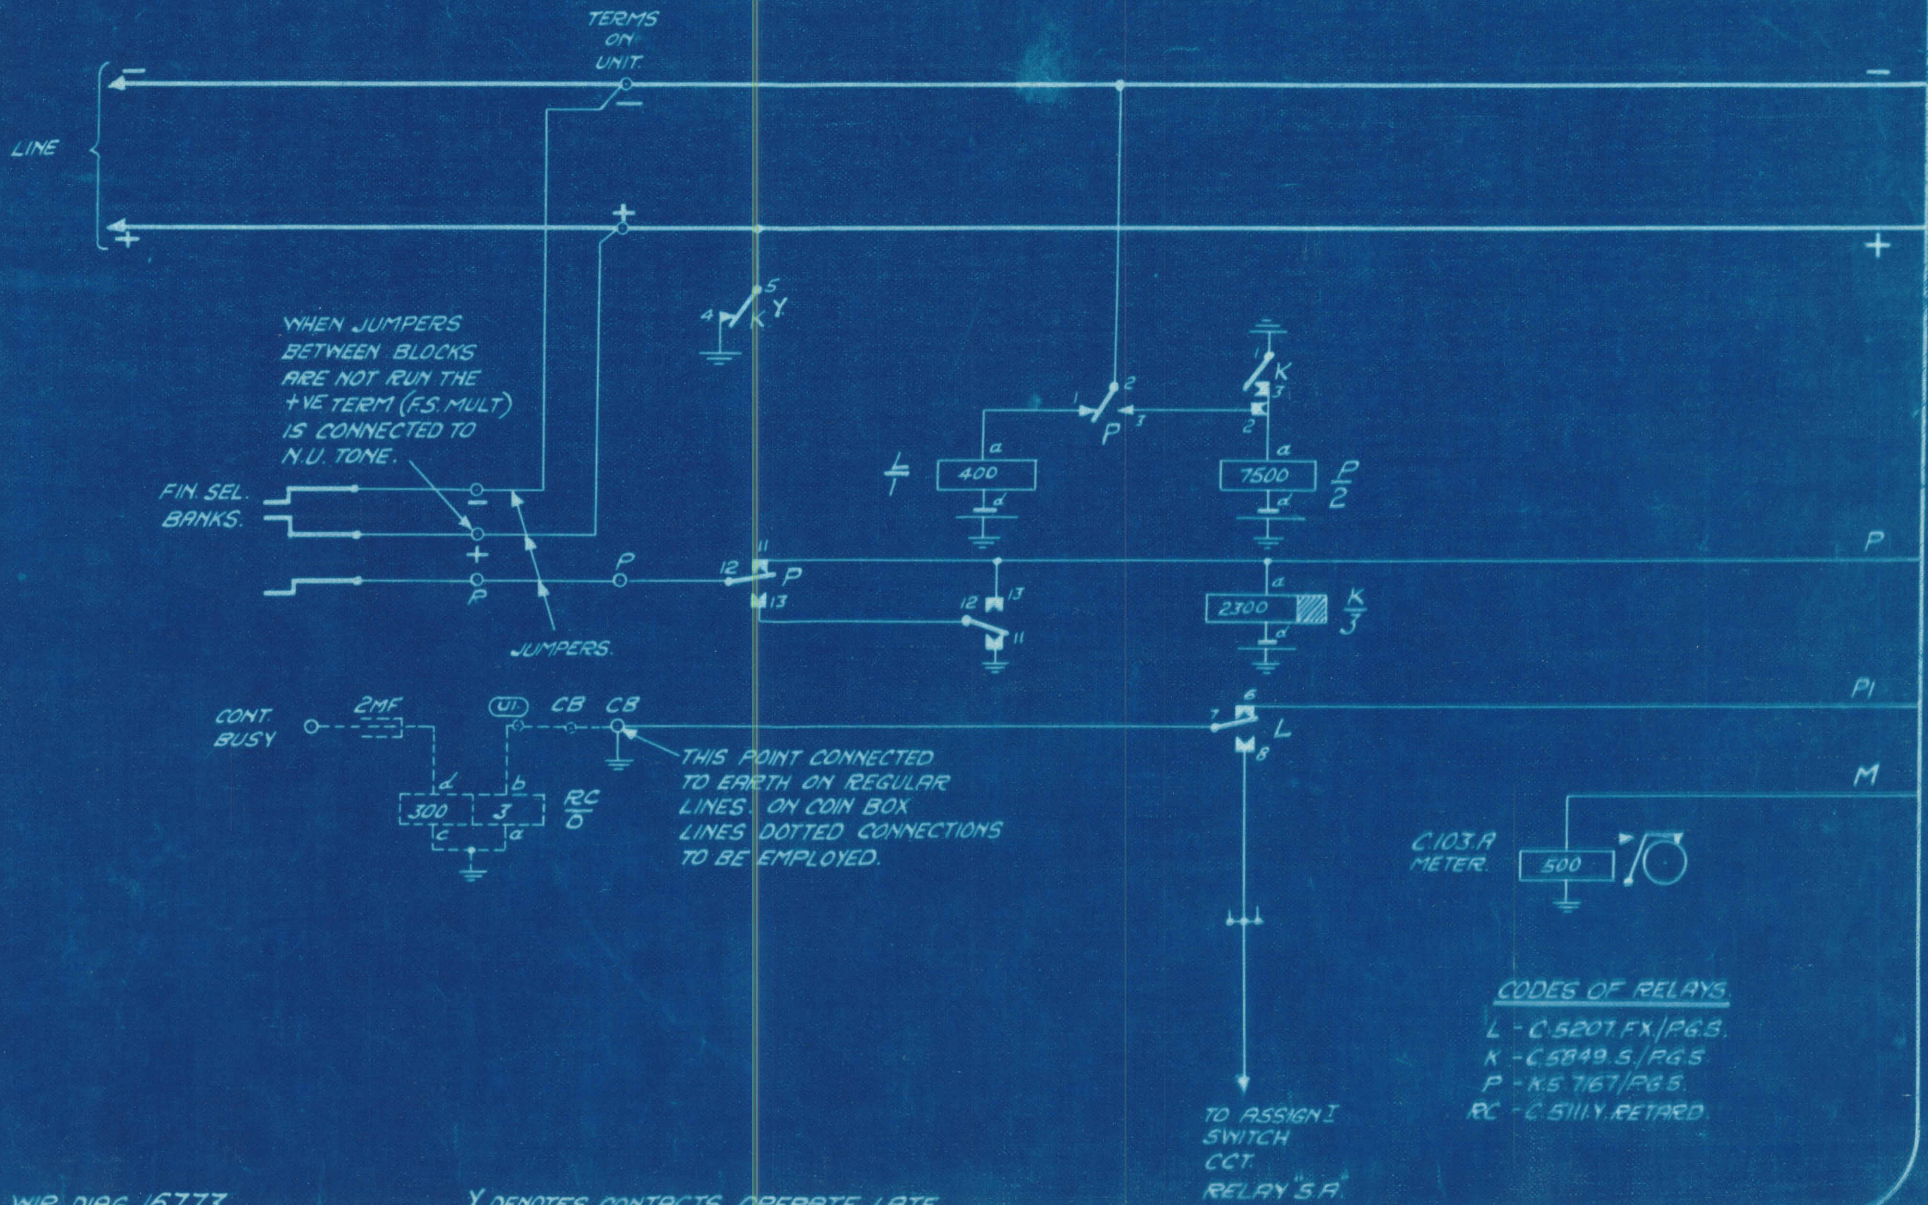

P.O. APPL. MADE FOR: G.P.O. STANDARD REF. 5467.

WIR. DIAG. 16773

Y. DENOTES CONTACTS OPERATE LATE.

TO ASSIGN I SWITCH CCT. RELAY S.A.

CODES OF RELAYS
L - C.5207 F.X / P.G.5.
K - C.5849 S / P.G.5.
P - K.S. 7167 / P.G.5.
RC - C.5111 Y. RETARD.