


TRCD C.M.	DRWN. [Signature]	CHKD. [Signature]	ISSUE	20-9-28	CONNECTIONS OF d772 WERE THE REVERSE
				A 6-12-28	C103 D SEL ^S WAS C.102 D. C. 113.
				B 18-12-29	BANK WAS C.103 A.

G.E.CO. LTD TEL. WKS. COVENTRY.

50V.P.A.X SYSTEM.

ASSIGNMENT SWITCH CIRCUIT

16774
DUPLICATE TRACING.

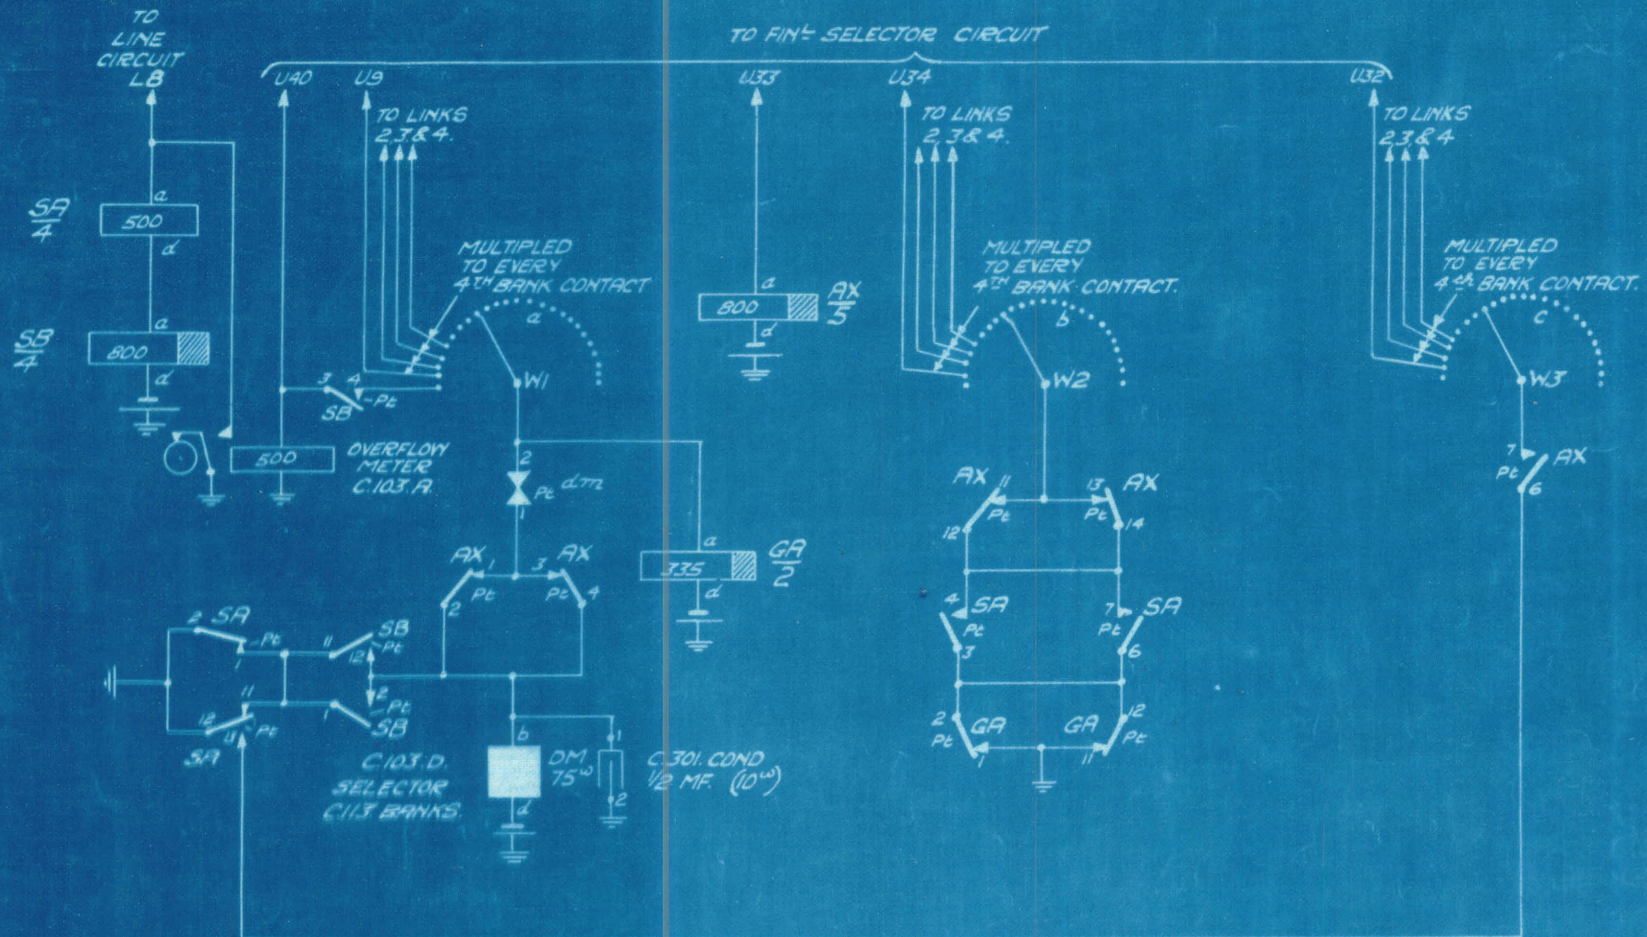

- MODELS OF RELAYS
 SA - C.5257.F
 SB - C.6543.X
 AX - C.5870.X
 GA - C.6805.M.

P.O. APPL. 2-11-28
 MADE FOR:
 G.P.O. STANDARDS
 REF. 3457

WIR. DIAG. 16775. Pt. DENOTES PLATINUM CONTACTS.